







Dual mount (black body)



Dual mount + Auxiliary (black body)







series (black body)

Features

- DC Circuit Breaker
- Hydraulic-Magnetic technology
- 100% rating capability, independent of ambient temperature
- VDE and CCC approved, CE certified
- UL listed (UL 489 A)
- Ratings 0.1 to 63 A (1 & 2 pole), 3 pole parallel (150 A maximum), 4 pole parallel (200 A maximum)
- Optional Auxiliary Switch / Trip Alarm factory fitted (6.5 mm wide)
- Optional Shunt Trip (no approvals)
- Wide range of time delays and operating currents
- Precision tripping characteristics
- Ultra compact 13 mm wide module
- Trip indication with mid-trip handle
- Reset immediately after overload
- DIN mount product in grey shells
- Dual mount product in black shells
- 80 V DC devices are reverse feedable
- 125 / 250 / 600 V DC devices are polarity sensitive
- Suitable to use for electrical isolation

Auxiliary Switch, Trip Alarm & Combo: **Features**

- AC and DC voltages
- UL 489 listed (Auxiliary Switch: 6 A 250 V AC, 0.5 A 80 V DC)
- IEC 60947-5-1 approved (Auxiliary Switch: 6 A 240 V AC, 0.5 A 110 V DC; Trip Alarm: 6 A 240 V AC, 0.5 A 110 V DC)
- Factory fitted
- Attached to right hand side of Circuit Breaker
- Compact 6.5 mm width

Applications

- DC branch circuit protection (UL 489A, IEC / EN 60947-2)
- Telecom / datacom equipment
- **UPS** equipment
- Alternative energy equipment
- Battery protection & switching
- Telecommunication DC power distribution
- Railway signalling equipment

Optional Accessories

- Auxiliary Switch (DIN and Dual Mount)
- Auxiliary Switch + Trip Alarm (Dual Mount only)
- Trip Alarm (Dual Mount only)
- Handle lock
- Surface mounting clips
- Busbar
- 57 mm Escutcheon blank (Dual Mount only)
- 57 mm Safety blank (Dual Mount only)



Technical Data

Approvals	IEC / EN 60947-2, VDE								
Number of Poles	1	2	2 parallel	2 parallel	3 parallel	4 parallel	2 series	I pole plug-in	
Operating Voltages	80 V DC,	125 V DC	80 V DC	125 V DC	80 V	DC 250 V DC		80 V DC	
Minimum Current Rating	0.1 A	0.1 A	60 A	30 A	II0A	200 A	0.1 A	0.1 A	
Maximum Current Rating	63 A	50 A	100 A	100 A	150 A	200 A	50 A	50 A	
Interrupting Capacity	oting Capacity 10 kA								
Operating Temperature Range	-40°C to +85°C								
Mounting Options	DII	DIN Rail, Dual mounting (DIN & Mini), surface mounting clip, plug-in terminal							
Time Delay Curves	I, 9, U2, U3, OP								

Approvals		UL 489A							
Number of Poles	I	2	2 parallel	2 parallel	3 parallel	4 parallel	2 series	4 series	I pole plug-in
Operating Voltages	80 V DC,	125 V DC	80 V DC	I25 V DC	80 / 125 V DC	80 V DC	250 V DC	600 V DC	80 V DC
Minimum Current Rating	0.1 A	0.1 A	30 A	20 A	II0 A	200 A	0.1 A	0.1 A	0.1 A
Maximum Current Rating	63 A	50 A	100 A	100 A	150 A	200 A	50 A	20 A	50 A
Interrupting Capacity					I0 kA				
Operating Temperature Range	-40°C to +85°C								
Mounting Options	DIN Rail, Dual mounting (DIN & Mini), surface mounting clip, plug-in terminal							al	
Time Delay Curves	I, 9, U2, U3, OP								

Approvals	ССС								
Number of Poles	I	2	2 parallel	3 parallel	4 parallel	I pole plug-in			
Operating Voltages	80 V DC								
Minimum Current Rating	0.1 A	0.1 A	30 A	II0A	200 A	0.1 A			
Maximum Current Rating	63 A	50 A	100 A	150 A	200 A	50 A			
Interrupting Capacity	I0 kA								
Operating Temperature Range	-40°C to +85°C								
Mounting Options	DIN Rail, Dual mounting (DIN & Mini), surface mounting clip, plug-in terminal								
Time Delay Curves	I, 9, U2, U3, OP								

Breaker QY	Wire Size mm² (IEC)	Wire Gauge (UL)	Torque (IEC)	Torque (UL)	Comments
I Pole & 2 Pole	0.75 - 35 mm²	18 – 2 – AWG	2.5 Nm	20 in-lb	Pozidriv #2 Combi head
2 Pole Parallel	50 mm ²	14 – 1/0 – AWG	3.2 Nm	28 in-lb	Bridge Terminal
3 Pole Parallel	95 mm ²	14 – 5/0 – AWG	5.6 Nm	50 in-lb	Bridge Terminal
4 Pole Parallel	95 mm ²	14 – 5/0 – AWG	5.6 Nm	50 in-lb	Bridge Terminal



Long Code

Example Code: QY---A-3(13)-D-U2-150A-B0----Z

Requirement	QY Frame	Switch / Neutral	Auxiliary	Triple pole	13 mm module width	DIN Rail	Mediur delay curve U	Rating	Voltage 80 V DC	No Shunt Trip	Future use	Parallel bridged (by customer)	
Long Code	QY	-	Α	3	(13)	D	U2	150A	В0	-	-	Z	
Group I:	Code			Description	on				Co	mments			
Frame Type	QY	13 mm wide Miniature Circuit Breaker						UL 489A, IEC / EN 60947-2, VDE, CE, CCC					
Group 2: Switch/Neutral	Code	Description						Comments					
	-	Not applicable						Overload poles do not have any further coding					
Group 3: Auxiliary	Code	Description						Comments					
- Auxiliar y	-			Not applica		1-1				if no Auxilia		L M t)	
	A T		Auxiliary Sw Trip Alarm (•			,	6.5 mm module 6.5 mm modul			`	•	
	AT		witch + Trip	· · · · · · · · · · · · · · · · · · ·		<u>, </u>	2)	6.5 mm modul				• • •	
Group 4:	Code	7 tuxillar y 5	witch inp	Description		in i modul		0.5 mm modu		mments	c (Buai 110	une only)	
No of Poles	I			Single pol									
	2			Double po									
	3			Triple pol	e								
	4			Four pole	•								
Group 5:	Code			Description	on				Co	mments			
Module Width	(13)		13	mm module	width				13 m	m per pole			
Group 6: Mounting	Code			Description						mments			
Mounting	D	DIN rail mount – 45 mm Escutcheon, grey body						DIN mount supplied in grey only					
C 7.	DM	Dι	ıal mount – 5			body		Dual mount supplied in black only					
Group 7: Time Delays	Code	Description				In:	Instantaneous Trip Point (x In) Comments						
	9	Long time delay, high instantaneous trip					10 – 20 Orange handle 7 – 12 White handle						
	U2			Long time de edium time				5 – 10 White handle				-	
	U3			Short time d	,			3 – 5 White handle					
	OP			Instantaneo				None White handle					
Group 8:			Code /	Description						mments			
Current Ratings	0.1, 0.2	, 0.2, 0.3, 0.5, 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 12, 15, 16, 20, 25, 30, 32, 35, 40, 45, 50, 60, 63, 70, 80, 90, 100, 120, 125, 150, 200 A					.	Ratings available vary depending on certification, bridging configuration and voltage. (See comments in Group 9) * Other ratings are available as special orders. Check availability.					
Group 9:	Code	Voltage		De	scription				Со	mments			
Voltage (see diagram	В0	80 V DC		Not pol	larity sensitiv	re	0	0.1 - 63 A I pole, 0.1 - 50 A 2 pole, 60 - 100 A 2 pole p (80 V DC), 30 - 100 A 2 pole parallel (125 V DC), I 10 - 150 A 3 pole parallel, 200 A 4 pole parallel			DC),		
on page 7)	ВІ	125 V DC			ive. Positive			(ratings a	vailable vary	depending o	n certificati	on)	
	B2	250 V DC	·	Positive =	es bridged (2 pole I bott	om		0.1 - 50 A 2 p	pole I (-) to pole 2 (+) ' '	,	
	В3	250 V DC		Positive =	s bridged (2 pole I bott	om		0.1 - 50 A 2 p	pole I (-) to pole 2 (+) ` `	, ,	
	B4	4 poles in series bridged (4 x 125 V) Positive = pole I bottom						0.1 - 20 A 4 pole series bridged (factory fitted) As per wiring diagram printed on unit					
	TI	125 V DC			sitive. Positiv	<u>'</u>			A 3 pole pa	rallel, 200 A	4 pole para	allel	
	T2	250 V DC		Positive	es bridged (2 e = pole 1 to	P		0.1 - 50 A 2 pole series bridged at the bottom (by customer) pole I (-) to pole 2 (+)					
	Т3	250 V DC 2 poles in series bridged (2 x 125 V) Positive = pole 1 top						0.1 - 50 A 2 pole series bridged at the bottom (factory fitted) pole I (-) to pole 2 (+) 0.1 - 20 A 4 pole series bridged (factory fitted)					
	T4	600 V DC	4 poles in series bridged (4 x 125 V) Positive = pole 1 top							ries bridged (iagram printe		(d)	

Continues on page 4





Long Code continues

Group 10:	Code	Description	Comments					
Shunt Trip	-	Not applicable	Use this code if no Shunt Trip is used					
(not certified,	V0	100 – 480 V	Fly leads (approximately 60 mm long)					
only offered as	V5	100 – 480 V	Internally connected					
special order)		Other voltages are availa	able as special orders. Check availability.					
Group II	Code	For future use (-)						
Group 12:	Code	Description	Comments					
Special Termination	-	Not applicable	Use this code if no special terminations are used					
Termination	Р	Plug-in						
	Z	Bridged unit (bridge to be fitted by customer)						
	ZL	Bridged unit (factory fitted)						

For options not listed, please contact CBI for assistance


Time Delay Curves

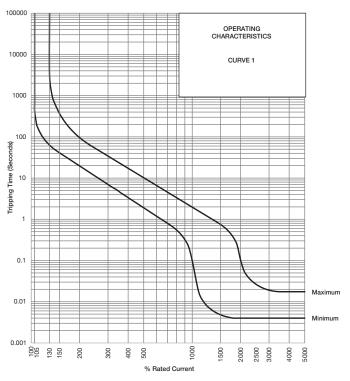


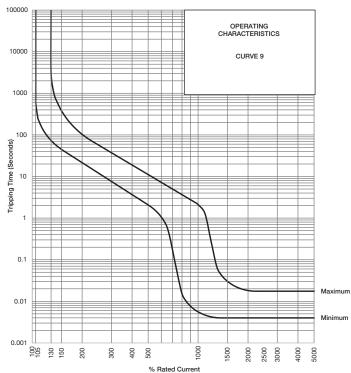




Time Delay Curves

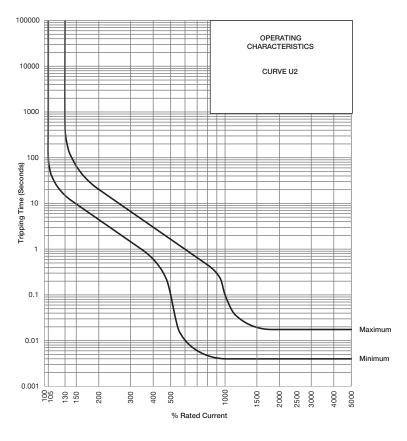

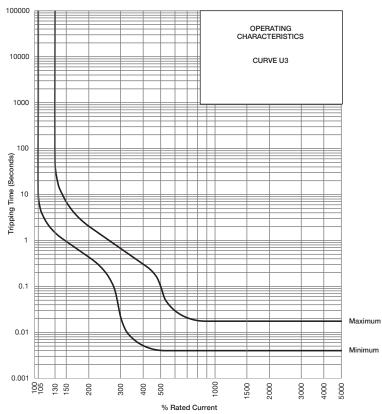




Time Delay Curves

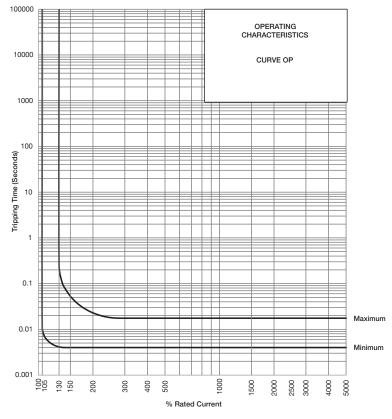

^{*} The published time delay curves are generated at 30°C ambient temperature with the Circuit Breaker mounted in the up-right position. The "must hold", "must trip" and "instantaneous trip" current values are not affected by temperature, although delay time for the other operating current values may have to be adjusted using the temperature compensation curve which is available on request.

Internal Resistance vs Current Rating

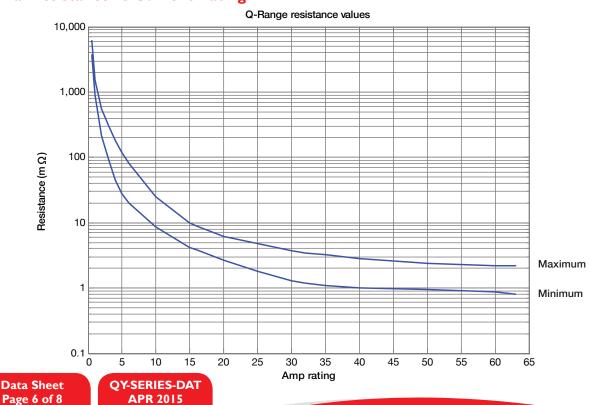



_ Ø 1.4

[Ø₁0.055]

[0.0315]


QY - Series Miniature Circuit Breakers

Typical outline of Auxiliary Switch / Trip Alarm

Auxiliary available (6.5 mm module width) to match the unit to which it is attached.

Available types as listed in Group 3:

- Type T Trip Alarm as shown in outline drawings (fitted on a Dual mount product)
- Type AT Auxiliary Switch + Trip Alarm (as shown)

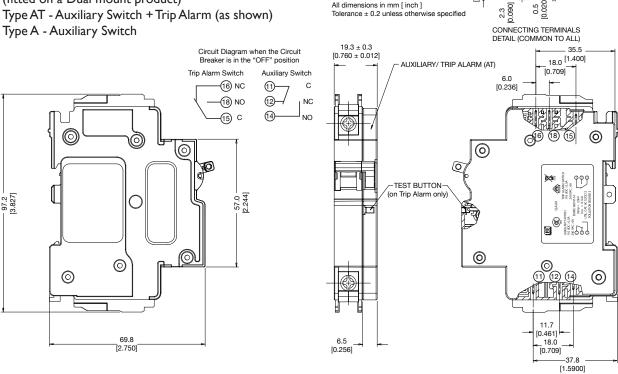


Typical outline for an Auxiliary module attached to a Dual mount single pole

All dimensions in mm [inch]

Circuit Breaker


Polarity identification


Diagram identifying the polarity of 125 V DC products in reference to Group 9 on page 3. Devices are shown viewed from the front. Series devices (standard) - each pole is opposite polarity from the next pole on the left (bridged "-" to "+"). Parallel devices - each pole has the same polarity (bridged "+" to "+", "-" to "-").

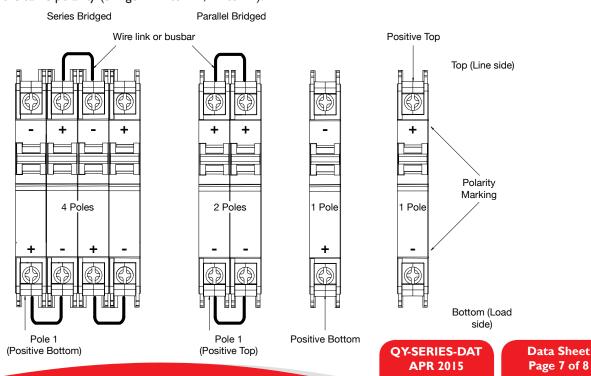





Outline Dimensions: Dual mount

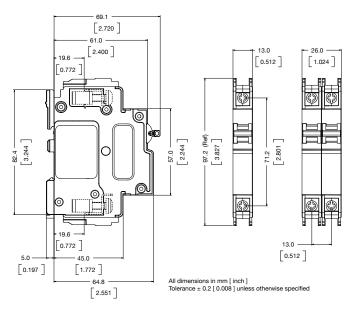








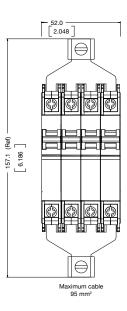


Outline Dimensions: DIN mount

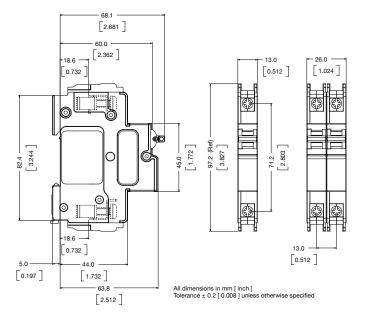





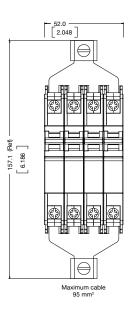

Plug-in terminal dimensions available on request

Please review our Customer Terms and Conditions on www.cbi-lowvoltage.co.za

All rights reserved. Unless otherwise indicated, all materials on these pages are copyrighted by CBI (Pty) Ltd. No part of these pages, either text or image may be used for any purpose other than personal use. Therefore, reproduction, modification, storage in a retrieval system or retransmission, in any form or by any means, electronic, mechanical or otherwise, for reasons other than personal use, is strictly prohibited without prior written permission. CBI (Pty) Ltd reserves the right to alter any details of this document without notice and while every effort is made to ensure the accuracy of the content, no warranty is given as to accuracy of this document and no responsibility will be accepted for error or misinterpretation and any resulting loss.

AUSTRALIA

CBI-electric: Australia

90 Fairbank Road Clayton South Melbourne Victoria 3169 Australia Tel: +61 3 9590 3500 Fax: +61 3 9551 1051

Email: sales@cbi-electric.com.au

Website: www.cbi-electric.com.au

SOUTH AFRICA

CBI-electric: low voltage

Tripswitch Drive Elandsfontein Gauteng 1401 South Africa Tel: +27 | 1 | 928 2000 Fax: + 27 11 392 2354 Email: cbi@cbi-electric.com Website: www.cbi-lowvoltage.co.za

CBI-electric: North America

35 E. Uwchlan Ave Suite 328 Exton PA 19341 USA Tel: +1 610 524 9949 Fax: +1 610 524 9945

E-mail: info@cbibreakers.com Website: www.cbibreakers.com